AGREEMENT FOR INTERCONNECTION AND OPERATION OF DISTRIBUTED GENERATION

	This Interconnection Agreement ("Agreement") is made and entered into thisday
of	, 20, by Concho Valley Electric Cooperative, Inc., ("Cooperative"),
and_	, ("Member"), each
herei	nafter sometimes referred to individually as "Party" or both referred to collectively as the
"Part	ies."

WHEREAS, Cooperative is a non-profit corporation organized under the laws of the State of Texas;

WHEREAS, Cooperative is an electric cooperative which provides retail electric service to its members and consumers;

WHEREAS, Member is a member of the Cooperative;

WHEREAS, the Member desires to interconnect and operate its Member owned generating Facility ("DG Facility") in parallel with the Cooperative's electric power distribution system ("Cooperative System").

WHEREAS, when the context requires, singular nouns and pronouns include the plural.

NOW THEREFORE, in consideration of the mutual promises, warranties, agreements, and representations set forth herein, the receipt and sufficiency of which hereby are acknowledged, the Parties hereto hereby agree as follows:

This Agreement is applicable only to conditions under which Cooperative and Member agree that one or more DG Facilities (described in Exhibit A) with Rated Capacity or Nameplate Capacity of one hundred (100) kilowatt (kW) direct current (DC) or less, to be interconnected at four hundred eighty (480) volt or less, single phase or three phase, may be interconnected to the Cooperative System.

Nothing herein shall supersede any requirement of any applicable tariff, rule, regulation, or applicable law under which Cooperative currently operates.

GENERAL PROVISIONS

It is the intent of the Cooperative to allow Members to install Distributed Generation (DG), provided the Member's DG Facility does not adversely affect the Cooperative. The Member should conduct his or her own analysis to determine the economic benefit of DG operation.

A DG Facility that is not connected to the Cooperative System in any way is known as stand- alone

or isolated DG. The Member may operate a DG Facility in stand-alone or isolated fashion as long as such DG Facility does not adversely affect the Cooperative System. However, a DG Facility connected in any way to the Cooperative System shall be considered as in parallel. For purposes of this Agreement, a DG Facility is considered operating in parallel anytime it is connected to the Cooperative System in any way, even if the Member does not intend to export power. All provisions of this Agreement shall apply to parallel operation of DG Facilities as so defined. Members shall fully comply with this Agreement and any amendments thereto at the sole discretion of the Cooperative.

This Agreement does not contain a complete description or listing of all applicable laws, ordinances, rules and regulations, nor is this Agreement intended to be an installation or safety manual. The Member requesting to interconnect a DG Facility to the Cooperative System is responsible for and must follow, in addition to all provisions of this Agreement, the Cooperative's *Rules and Regulations and Tariffs for Electric Service*, the Cooperative's *Line Extension Policy*, the *Policies and Procedures* of the Cooperative's Power Supplier (as defined in the Tariff) where applicable, the *Policies and Procedures* of the Cooperative's transmission service provider where applicable, the current IEEE 1547 and other applicable IEEE standards, applicable ANSI standards, including ANSI C84.1 Range A and any other applicable governmental and regulatory laws, rules, ordinances or requirements. All legal, technical, financial, or other requirements in the following sections of this Agreement must be met prior to interconnection of the DG Facility to the Cooperative System.

A Member may serve all load behind the Cooperative billing meter at the location serving the DG Facility but will not be allowed to serve multiple billing meters, multiple consuming facilities or multiple Members with a single DG Facility or under a single DG application without prior written approval by the Cooperative.

SECTION I. DISTRIBUTED GENERATION FACILITY CATEGORY

Prior to application, Member shall determine the following for the proposed DG Facility:

1) Connection Level Category

Connected to the Cooperative System: The Member requests or the Member's DG Facility requires connection to the Cooperative System. All provisions of this Agreement cover this category.

2) Power Export Category

- a) Parallel no power export:
 The Member operates a DG Facility connected in any way to the Cooperative System but with no intention to export power.
- b) Parallel power generated to be both consumed and exported:

The Member operates a DG Facility connected in any way to the Cooperative System designed primarily to serve the Member's own load but with the intention to export excess power.

3) Qualifying or Non-Qualifying Category

- a) Qualifying Facilities (QF) are defined by the Public Utility Regulatory Policies Act of 1978 (PURPA). Refer to CFR Title 26, Volume 4, Sec. 292.204.
- b) The distinction between QF and Non-Qualifying Facilities (NQF) is based on the Facility's fuel source.
 - (1) Generally, a QF must have as its primary energy source biomass, waste, renewable resources, geothermal resources or any combination thereof. See guidelines contained in PURPA for a full description.
 - (2) DG Facilities not designated as QF under the provisions of PURPA will be considered NQF by the Cooperative.
- c) The Cooperative will provide interconnection for a DG Facility to Members, subject to the provisions of this Agreement and all other applicable rules and regulations.
- d) The Cooperative will purchase power from a Member with a DG Facility that is a QF, subject to the provisions of this Agreement and other applicable rules and regulations.
- e) The Cooperative in its sole discretion may purchase power from a Member with a DG Facility that is an NQF.

4) Size Category

Facilities 100 kW DC and smaller: Facilities less than or equal to 100 kW DC of connected generation will be placed in this size category unless the Member requests connection under the provisions of this Agreement applicable to facilities greater than 100 kW DC size category.

SECTION II. MEMBER'S INITIAL REQUIREMENTS

Prior to installation, Member shall comply with the following:

1) Notification

The Member must meet all the Cooperative's membership and service requirements in addition to the requirements found in this Agreement.

2) <u>Service Request</u>

a) In advance of installation of generation or DG equipment, the Member must complete a Concho Valley Electric Application for Interconnection and Operation of Customer-Owned Generation" ("Application") attached hereto as Exhibit A and incorporated herein by reference and submit it to the appropriate Cooperative address. b) A separate form must be submitted for each Facility.

3) Submit a DG Facility Plan

- a) Member shall complete an Application, which includes detailing the electrical design, interconnection requirements, size, operational plans for the DG Facility, and a one-line diagram (the "DG plan"). Either at the time of submission or at any time during the review process, the Cooperative may require additional information or may require the DG plan to be prepared by a Professional Engineer registered in the state of Texas.
- b) Prior to review of the application and DG plan by the Cooperative, the Member shall pay an application fee as indicated below. A separate fee must be submitted for each DG Facility.

DG Size (Connected Load)	Application Fee	Engineering Fee	Interconnection Fee
≤15 kW DC	\$100	\$0	\$200
>15 kW to 50 kW DC	\$100	\$100	\$200
>50 kW to 100 kW DC	\$150	\$150	\$200

c) For proposed DG installations over 15 kW DC, Member shall provide Cooperative with sufficient information for Cooperative to conduct a study to determine the maximum DG installation size at the Member's proposed location.

SECTION III. COOPERATIVE AND POWER SUPPLIER REVIEW PROCESS

1) Plan Review Process

- a) The Cooperative will review the Application and accompanying documents, plans, specifications, and other information provided and will return an interconnection analysis to the Member within ninety (90) calendar days of receipt of final plans and specifications.
- b) Technical review will be consistent with guidelines established by the most recent *IEEE Standard 1547 Guide for Distributed Generation Interconnection.* The Member may be required by the Cooperative to provide proof that their DG Facilities have been tested and certified by applicable IEEE guidelines.
- c) If corrections or changes to the plans, specifications, and other information are to be made by the Member, the ninety (90) day review period may be reinitialized when proof of such changes or corrections are provided to the Cooperative. In addition, any changes to the site or project requiring new analysis by the Cooperative may require additional cost and a new DG plan. The cost will be determined by the Cooperative and shall be paid by the Member.
- d) The Member acknowledges and agrees that any review or acceptance of such plans,

specifications, and other information by the Cooperative shall not impose any liability on the Cooperative and does not guarantee the adequacy of the Member's equipment or DG Facility to perform its intended function. The Cooperative disclaims any expertise or special knowledge relating to the design or performance of generating installations and does not warrant the efficiency, cost-effectiveness, safety, durability, or reliability of such DG installations. Installation and operation of the DG Facility shall at all times be at the Member's sole risk and sole expense.


- e) In the event it is necessary at the time of initial interconnection or at some future time for the Cooperative to modify electric delivery systems in order to serve the Member's DG Facilities or purchase or continue to purchase the output of the Member's DG Facilities, or because the quality of the power provided by the Member's DG Facilities adversely affects the Cooperative's delivery system, the Member will be responsible to pay the Cooperative in advance for all costs of modifications required for the interconnection of the Member's DG Facilities.
- f) There will be a charge of \$100 added to the application fee after two failed submittal attempts (per meter). It is recommended to fully review this interconnection agreement, the DG Guidelines and use the checklist provided with the DG Guidelines in order to submit what the Cooperative considers a complete application.

SECTION IV. SALES TO AND PURCHASES FROM A DG FACILITY

1) For all DG where the Member desires to export power

- a) All DG Facilities shall be billed under one of the Cooperative's existing rate Tariffs.
- b) All sales of electric power and energy by the Cooperative to a Member shall be consistent with the applicable retail rate schedule established by the Cooperative as if there were no DG installation at the Member's premises, including any charges in the Cooperative's DG Tariff.
- c) The Member shall pay all rates and charges so listed in the applicable rate Tariff. In addition to all other charges, the Cooperative may bill the Member for any additional facilities charges as determined in the sole discretion of the Cooperative.
- d) Neither the Cooperative nor its Power Supplier is under any obligation to purchase power from a NQF. However, the Cooperative may, at its sole discretion, purchase power from an NQF.
- e) The type of metering to be used shall be specified at the sole discretion of the Cooperative. An approved load profile meter is required, which can be remotely read by the Cooperative through an approved communications link.
- f) The Member shall be subject to any market-related charges related to the Member's DG Facility, including but not limited to Scheduling, Dispatching and Energy imbalance.
- g) Net metering shall not be used.
- h) For power produced in excess of on-site requirements (out-flow), the Cooperative will purchase out-flow at Avoided Cost (as defined by the Tariff). The Cooperative shall bill the

- Member for the energy supplied by the Cooperative as metered by the billing meter during each billing period according to the Cooperative's applicable retail rate schedule. See Figure 1. below for an illustration.
- In addition to all other charges, the Cooperative may bill the Member for any additional facilities charges, billing charges, meter reading charges or customer service costs as determined by the Cooperative and appended to this Agreement.
- j) The Cooperative shall not be required to make any purchases that will cause the Cooperative to no longer be in compliance with any applicable contracts or all-power contract requirements with its Power Supplier.

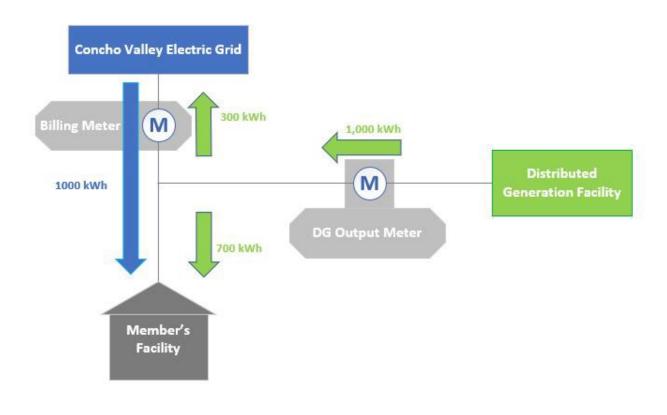

Delivered to Member from Cooperative - 1000 kWh

Received by Cooperative from Member - 300 kWh

Figure 1. Illustration of Payment by Cooperative to Member of Avoided Cost for Received and Charge by Cooperative to Member of Retail Rate for Delivered.

SECTION V. MEMBER'S RESPONSIBILITY PRIOR TO OPERATION

1) Line Extension and Modifications to Cooperative Facilities

- a) As a part of the interconnection analysis performed by the Cooperative, the Member will be provided with an estimate of any line extension or other cost to be incurred in providing electric delivery service to the Member's DG Facility.
- b) Notwithstanding the Cooperative's line extension policy, the Member shall pay in advance the full cost of the construction of any transmission, substation, distribution, transformation, metering, protective, or other facilities or equipment which, is required, in the sole discretion of the Cooperative, to serve the Member's DG Facility.
- c) In the event it is necessary at the time of initial interconnection or at some future time for the Cooperative to modify electric delivery systems in order to serve the Member's DG Facilities or purchase or continue to purchase the Member's output, or because the quality of the power provided by the Member's DG Facilities adversely affects the Cooperative's delivery system, the Member will reimburse the Cooperative for all costs of modifications required for the interconnection or continued of the Member's DG Facilities.
- d) In all cases, the Member shall pay the full cost of the installation of a visible load break disconnect switch by and to the sole specification of the Cooperative. The switch will be readily accessible to Cooperative personnel and of a type that can be secured in an open position by a Cooperative lock.

2) Applicable Regulations

The DG Facility shall be installed and operated by Member subject to and in accordance with the terms and conditions set forth in the Cooperative's rules, regulations, bylaws, rates and Tariffs, as amended from time to time, and, if applicable, approved by the Cooperative's Board of Directors, which are incorporated herein by reference, and in compliance with all applicable federal, state and local laws, regulations, zoning codes, building codes, safety rules, environmental restrictions, ordinances and regulations, including without limitation, the most recent IEEE Standard 1547 Guide for Distributed Generation Interconnection, applicable ANSI standards, including ANSI C84.1 Range A, Electric Reliability Council of Texas (ERCOT) Independent System Operator (ISO) directives and ERCOT guidelines, and in accordance with industry standard prudent engineering practices.

3) <u>Liability Insurance</u>

a) Facilities 100 kW DC and smaller

- (1) Prior to interconnection, the Member must provide proof that all equipment carries a warranty against breakdown and undue degradation for a minimum of five (5) years.
- (2) No liability insurance is required in addition to what the Member would have in the absence of the DG installation, but proof may be required to ensure standard

homeowner liability coverage has not been negated by endorsement or policy exclusions. Upon request, Member will provide a copy of its insurance policy as proof that it has liability coverage.

4) <u>Initial Interconnection</u>

- a) Upon satisfactory completion of the review process and execution of this Agreement, the Cooperative will begin installation of the interconnection of DG Facilities. The interconnection will be completed as soon as practical after completion of the review process and execution of the necessary agreements and contracts. After completion of interconnection requirements and prior to initiation of service, the applicant must provide pictures of the installation to schedule the final inspection of the DG Facilities and interconnection to the Cooperative System. Upon satisfactory final inspection, the Cooperative will initiate service to the Member.
- b) If the post inspection fails the first time, there will be an inspection fee of \$100 for each inspection thereafter.
- c) The Cooperative's review process and final inspection is a means to safeguard the Cooperative's facilities and personnel. The Member acknowledges and agrees that any review or acceptance of such plans, specifications, and other information by the Cooperative or its Power Supplier shall not impose any liability on the Cooperative or its Power Supplier and does not guarantee the adequacy of the Member's equipment or DG Facility to perform its intended function. The Cooperative disclaims any expertise or special knowledge relating to the design or performance of Member's specific generating installation and does not warrant the efficiency, cost-effectiveness, safety, durability, or reliability of such DG installation.

SECTION VI. REFUSAL TO INTERCONNECT SERVICE OR DISCONNECTION OF INTERCONNECTION SERVICE

The Cooperative may, at its sole discretion, prevent the interconnection or disconnect the interconnection of DG Facilities due to reasons such as safety concerns, reliability issues, power quality issues, breach of interconnection contract, or any other issue which the Cooperative considered to be a basis for such action. Any disconnection may be without prior notice.

SECTION VII. OPERATION OF PARALLEL FACILITY

The purpose of this section is to outline Members' responsibilities concerning Cooperative's operational requirements for DG Facilities operated in parallel with the Cooperative System and is not intended to be a complete listing of all operational, regulatory, safety and other requirements.

1) Ownership of facilities

- a) The Member shall own and be solely responsible for all expense, installation, maintenance, and operation of all facilities, including all power generating facilities, at and beyond the Point of Delivery (as defined in the Tariffs).
- b) At its sole discretion, the Cooperative may locate Cooperative-owned metering equipment and transformers past the Point of Delivery.
- c) Members shall be allowed to install up to 110% kW DC of their consecutive 12-month peak load.

2) <u>Self-Protection of DG Facilities</u>

- a) The Member shall furnish, install, operate and maintain in good order and repair all equipment necessary for the safe operation of DG Facilities operated in parallel with the Cooperative System.
- b) The Member's equipment shall have the capability to both establish and maintain synchronism with the Cooperative System and to automatically disconnect and isolate the DG Facility from the Cooperative System.
- c) The Member's DG Facility shall be designed, installed, and maintained to be self-protected from normal and abnormal conditions on the Cooperative System including, but not limited to, overvoltage, undervoltage, overcurrent, frequency deviation, and faults. Selfprotection will be compatible with all applicable Cooperative protection arrangements and operating policies.
- d) Additional protective devices and functions may be required by the Cooperative when, in the sole judgment of the Cooperative, the DG Facility installation or the Cooperative System characteristics so warrant.

3) Quality of service

- a) The Member's DG Facility shall generate power at the nominal voltage of the Cooperative System at the Member's delivery point as defined by ANSI C84.1 Range A.
- b) Member's DG Facility shall generate power at a frequency within the tolerances as defined by IEEE 1547.
- c) Member's DG Facility shall produce power at a minimum power factor of at least 95% or shall use power factor correction capacitors to ensure at least a 95% power factor.
- d) Member's DG Facility shall be in accordance with the power quality limits specified in IEEE 519.
- e) The overall quality of the power provided by the Member's DG Facility including, but not limited to, the effects of harmonic distortion, voltage regulation, voltage flicker, switching surges and power factor, shall be such that the Cooperative System is not adversely affected in any manner.
- f) In the event that adverse effects are caused in whole or in part by the Member's DG Facility, the Member shall correct the cause of such effects within 30 days of the initial adverse effect, and if applicable, reimburse the Cooperative for the required correction. The Cooperative reserves the right to disconnect the Member's DG Facility if the

- Cooperative determines adverse effects exist which warrant immediate disconnection, including but not limited to circumstances described in Section VII.4., below.
- g) The Cooperative may perform an inspection on the DG Facility at any time.

4) <u>Safety disconnect</u>

- a) The Member shall install a visible load break disconnect switch at the Member's expense and to the Cooperative's specifications.
- b) The switch shall be located so as to be readily accessible to Cooperative personnel in a location acceptable to both the Member and Cooperative. Generally acceptable locations include: (1) the switch being located within 10 feet of the billing meter or (2) a placard located within 10 feet of the billing meter giving a description of the switch's location.
- c) The switch shall be of a type that can be secured in an open position by a lock owned by the Cooperative. If the Cooperative has locked the disconnect switch open, the Member shall not operate or close the disconnect switch.
- d) The Cooperative shall have the right to lock the switch open when, in the sole judgment of the Cooperative:
 - (1) It is necessary to maintain safe electrical operating or maintenance conditions,
 - (2) The Member's DG Facility adversely affects the Cooperative System, or
 - (3) There is a system emergency or other abnormal operating condition warranting disconnection.
- e) The Cooperative reserves the right to operate the disconnect switch for the protection of the Cooperative System even if it affects the Member's DG Facility. In the event the Cooperative opens or closes the disconnect switch:
 - (1) The Cooperative shall not be responsible for energizing or restoration of parallel operation of the DG Facility.
 - (2) The Cooperative will make reasonable efforts to notify the Member.
- f) The Member shall not bypass the disconnect switch at any time for any reason.
- g) Signage shall be placed by the Cooperative at the Member's expense and located at the disconnect indicating the purpose of the switch, along with contact names and numbers of both the Member and the Cooperative.
- h) Members with DG Facilities as defined in this Agreement which are solely for the purpose of emergency backup or peak shaving without intent to export power shall not operate their DG Facilities at any time unless visibly disconnected from the Cooperative System. At its sole discretion, the Cooperative may require Member to install at his or her own expense an interlocking switch for the purpose of ensuring the Member's DG Facilities do not operate in parallel with the Cooperative's facilities.
- Should the Cooperative lose power serving the Member's DG Facilities for any reason, Members with DG Facilities shall not operate their DG Facilities unless visibly disconnected from the Cooperative System.

5) DG output meter

- a) For DF Facilities that plan to operate in parallel, a DG output meter is required. The Member shall install a meter socket at the Member's expense and to the Cooperative's specifications for the DG output meter.
- b) The meter socket shall be located so as to be readily accessible to Cooperative personnel in a location acceptable to both the Member and Cooperative. Generally acceptable locations include: (1) the meter socket being located between the DG output or inverter(s) and the safety disconnect switch or (2) between the safety disconnect switch and service panel for the residential or commercial load.
- c) A Cooperative owned meter will be provided for the DG output meter socket upon successful inspection of the DG Facility.
- d) The DG meter socket shall be wired according to the cooperative's specifications. Refer to Exhibit A.
- e) The Cooperative reserves the right to operate the DG output meter for the protection of the Cooperative System even if it affects the Member's DG Facility. In the event the Cooperative opens or closes the DG output meter:
 - (1) The Cooperative shall not be responsible for energizing or restoration of parallel operation of the DG Facility.
 - (2) The Cooperative will make reasonable efforts to notify the Member.
- f) The Member shall not bypass the DG meter at any time for any reason.

6) Access

- a) In addition to all other rights of the Cooperative, persons authorized by the Cooperative shall have the right to enter the Member's property for purposes of testing, operating the disconnect switch, reading or testing the metering equipment, maintaining right-of-way or other DG Facility equipment or Cooperative service requirement. Such entry onto the Member's property may be without notice.
- b) If the Member erects or maintains locked gates or other barriers, the Member will furnish the Cooperative with keys, codes, or other convenient means to circumvent the barrier for full access for the above-mentioned reasons.

7) <u>Liability for Injury and Damages and Indemnification</u>

- a) The Member assumes full responsibility for its DG Facility and all electric energy furnished at and past the point of interconnection. The Member shall indemnify the Cooperative against and hold the Cooperative harmless from all claims for both (i) injuries to persons, including death resulting therefrom; and (ii) damages to property, arising from electric power and energy delivered to Member by the Cooperative or in any way arising directly or indirectly from the Member's DG Facility.
- b) The Cooperative shall not be liable for either direct or consequential damages resulting from failures, interruptions, or voltage and waveform fluctuations occasioned by causes reasonably beyond the control of the Cooperative including, but not limited to, acts of God or public enemy, sabotage or vandalism, accidents, fire, explosion, labor troubles,

strikes, order of any court or judge granted in any bona fide adverse legal proceeding or action, or any order of any commission, tribunal or governmental authority having jurisdiction. ALL PROVISIONS NOTWITHSTANDING, IN NO EVENT SHALL THE COOPERATIVE BE LIABLE TO THE MEMBER FOR ANY INTEREST, LOSS OF ANTICIPATED REVENUE, EARNINGS, PROFITS, OR INCREASED EXPENSE OF OPERATIONS, LOSS BY REASON OF SHUTDOWN OR NON-OPERATION OF MEMBER'S PREMISES OR FACILITIES, OR ANY INDIRECT, INCIDENTAL, OR CONSEQUENTIAL, PUNITIVE OR EXEMPLARY DAMAGES ARISING OUT OF OR RELATED, IN WHOLE OR PART, TO THIS AGREEMENT. THE COOPERATIVE SHALL NOT BE LIABLE IN ANY EVENT FOR CONSEQUENTIAL DAMAGES.

- c) The Member is solely responsible for insuring its DG Facility complies with all applicable regulations including, but not limited to, laws, regulations, ordinances, Tariffs, policies and directives, and ERCOT rules, policies and directives.
- d) MEMBER AGREES TO INDEMNIFY, DEFEND, AND HOLD HARMLESS COOPERATIVE AND ITS OWNERS, PARTNERS, MEMBERS, PARENTS, SUBSIDIARIES, DIVISIONS AND AFFILIATES AND THEIR OFFICERS, DIRECTORS, EMPLOYEES AND AGENTS (COLLECTIVELY, THE "INDEMNITEES"), FROM AND AGAINST ANY AND ALL CLAIMS, SUITS, CAUSES OF ACTION, LIABILITY, DAMAGES, JUDGMENTS OR EXPENSES, INCLUDING, BUT NOT LIMITED TO, ATTORNEYS' FEES AND LITIGATION COSTS, FOR PERSONAL INJURIES, (INCLUDING, BUT NOT LIMITED TO, DEATH) OR PROPERTY DAMAGE, SUFFERED BY ANY PERSON OR ORGANIZATION (INCLUDING EMPLOYEES OF MEMBER OR ITS SUBCONTRACTORS AND EMPLOYEES OF COOPERATIVE OR ITS SUBCONTRACTORS) ARISING OUT OF OR IN ANY WAY CONNECTED WITH THIS AGREEMENT OR THE INTERCONNECTION, OPERATION, OR EXISTENCE OF ANY DISTRIBUTED ENERGY RESOURCE OR FACILITY OR THE PERFORMANCE OF MEMBER'S OBLIGATIONS UNDER THIS CONTRACT OR ANY CONTRACT WITH COOPERATIVE, EVEN IF CAUSED BY THE SOLE OR CONCURRENT NEGLIGENCE, GROSS NEGLIGENCE OR FAULT OF ANY INDEMNITEE, OR WHETHER BASED ON STRICT LIABILITY, WARRANTY, OR OTHERWISE. TO THE EXTENT THAT THE LAWS OF THE GOVERNING JURISDICTION PROHIBIT OR DECLARE UNENFORCEABLE THIS INDEMNIFICATION AS IT APPLIES TO ANY INDEMNITEES' OWN NEGLIGENCE OR FAULT, THEN THIS INDEMNIFICATION SHALL BE INTERPRETED TO OBSERVE SUCH PROHIBITION OR DECLARATION BUT ONLY TO THE EXTENT NECESSARY TO CAUSE IT TO BE CONSISTENT WITH LAWS OF SAID GOVERNING JURISDICTION AND TO CAUSE THE MAXIMUM INDEMNIFICATION OF INDEMNITEES AS ALLOWED THEREUNDER.
- e) Member further agrees that Cooperative shall have the exclusive right and sole authority to select attorneys of its choosing to represent its interest in any matter contemplated by the preceding indemnification provision. Member shall also pay any and all reasonable attorneys' fees and litigation costs associated with the services performed by the attorneys chosen by Cooperative.

8) Metering/Monitoring

- a) The Cooperative shall specify, install, and own all metering equipment.
 - (1) A meter is required on the output of all DG energy sources. This meter is referred to as DG output meter (refer to the sample one-line diagram in Exhibit A of this

- document). This meter will be provided and owned by the Cooperative.
- (2) A Cooperative billing meter will be in place that is capable of measuring power delivered and received. Power received by the Cooperative through the Cooperative billing meter will be purchased by the Cooperative at avoided cost.
- b) The meters shall be read at a time or times of the month determined at the Cooperative's sole discretion for acquiring metering data. The Member shall provide the Cooperative an approved communications link at the Member's cost for this purpose if so requested by the Cooperative. The type of communications link and metering equipment measuring purchase of power by the Cooperative shall be installed and specified at the sole discretion of the Cooperative.
- c) The Cooperative may, at its sole discretion, require the Member to pay the Cooperative in advance for metering and monitoring equipment and installation expense.
- d) Meter testing shall follow the Cooperative's standard policy on metering, testing, and accuracy.
- e) At its sole discretion, the Cooperative may meter the Facility at primary or secondary level.

9) Notice of Change in Installation

- a) The Member shall notify the Cooperative in writing thirty (30) days in advance of making any change affecting the characteristics, performance, or protection of the DG Facility.
- b) If any modification undertaken by the Member will create or has created conditions which may be unsafe or adversely affect the Cooperative System, the Member shall immediately correct such conditions or be subject to immediate disconnection from the Cooperative System.
- c) Any change in the operating characteristics of the DG Facility including, but not limited to, size of generator, total Facility capacity, nature of Facility, fuel source, site change, hours of operation, or type used, may require a new application process, including, but not limited to, application form, application fee, DG plan and DG plan review by the Cooperative.

10) Testing and Record Keeping

- a) The Member shall test all aspects of the protection systems up to and including tripping of the generator and interconnection point at start-up and thereafter as required. Testing shall verify all protective set points, relay and breaker trip timing and shall include procedures to functionally test all protective elements of the DG Facility. The Cooperative may witness the testing.
- b) The Member shall maintain records of all maintenance activities, which the Cooperative may review at reasonable times.

11) Disconnection of Service

due to reasons such as safety concerns, reliability issues, power quality issues, breach of interconnection contract or any other reasonable issue.

12) Compliance with Laws, Rules and Tariffs

The DG installation owned and installed by the Member shall be installed and operated subject to and in accordance with the terms and conditions set forth in the Cooperative's rules, regulations, bylaws, rates and Tariffs, as amended from time to time, and, if applicable, approved by the Cooperative's Board of Directors, which are incorporated herein by reference, and in compliance with all applicable federal, state and local laws, regulations, zoning codes, building codes, safety rules, environmental restrictions, ordinances and regulations, including without limitation, Electric Reliability Council of Texas (ERCOT) Independent System Operator (ISO) directives and ERCOT guidelines, and in accordance with industry standard prudent engineering practices.

SECTION VIII. CONFIDENTIALITY

Unless compelled to disclose by judicial or administrative process, or by other provisions of law or as otherwise provided for in this Agreement, Member and the Cooperative shall hold in confidence any and all documents and information furnished by the other party in connection with this Agreement.

SECTION IX. EFFECTIVE TERM AND TERMINATION

This Agreement becomes effective when executed by both Parties (the "Effective Date") and shall continue in effect until terminated. This agreement may be terminated as follows: (a) Member may terminate this Agreement at any time by giving the Cooperative sixty (60) days' written notice; (b) Cooperative may terminate upon failure by the Member to generate energy from the Facilities in parallel within six (6) months after completion of the interconnection; (c) either Party may terminate by giving the other Party at least thirty (30) days prior written notice that the other Party is in default of any of the terms and conditions of the Agreement or the rules or any rate schedule, Tariff, regulation, contract, or policy of the Cooperative, so long as the notice specifies the basis for termination; (d) Cooperative may terminate by giving Member at least sixty (60) days' notice in the event that there is a material change in an applicable law, or any requirement of the Cooperative's Power Supplier or any transmission utility, independent system operator or regional transmission organization having responsibility for the operation of any part of the Cooperative System.

SECTION X. VENUE

Venue for any dispute arising under this Agreement lies exclusively in the Texas State Court of Tom Green County, Texas.

SECTION XI. SEVERABILITY

If any portion or provision of this Agreement is held or adjudged for any reason to be invalid or illegal or unenforceable by any court of competent jurisdiction, such portion shall be deemed separate and independent, and the remainder of this Agreement shall remain in full force and effect.

SECTION XII. ENTIRETY OF AGREEMENT

This Agreement, including the rules and all attached Exhibits and Facilities Schedules, which are expressly made a part hereof for all purposes, constitutes the entire agreement and understanding between the Parties with regard to the interconnection of the facilities of the Parties at the points of interconnection expressly provided for in this Agreement. The Parties are not bound by or liable for any statement, representation, promise, inducement, understanding, or undertaking of any kind or nature (whether written or oral) with regard to the subject matter hereof not set forth or provided for herein or in the Member Application, or other written information provided by the Member in compliance with the rules. It is expressly acknowledged that the Parties may have other agreements covering other services not expressly provided for herein, which agreements are unaffected by this Agreement.

SECTION XIII. FORCE MAJEURE

For the purposes of this Agreement, a Force Majeure event is any event: (a) that is beyond the reasonable control of the affected party; and (b) that the affected party is unable to prevent or provide against by exercising reasonable diligence, including the following events or circumstances, but only to the extent that they satisfy the preceding requirements: acts of God, acts of war, public disorder, rebellion or insurrection; floods, hurricanes, earthquakes, lightning, storms or other natural calamities; explosions or fires; strikes, work stoppages or labor disputes; embargoes; epidemics or pandemics; and sabotage. If a Force Majeure event prevents a party from fulfilling any obligations under this agreement, such party will promptly notify the other party in writing and will keep the other party informed on a continuing basis as to the scope and duration of the Force Majeure event. The affected party will specify the circumstances of the Force Majeure event, its expected duration and the steps that the affected party is taking to mitigate the effect of the event on its performance. The affected party will be entitled to suspend or modify its performance of obligations under this Agreement but will use reasonable efforts to resume its

performance.

SECTION XIV. ASSIGNMENT OF AGREEMENT

At any time during the term of this Agreement, the Member may assign this Agreement to a corporation, an entity with limited liability or an individual (the "Assignee"), provided that the Member obtains the consent of the Cooperative in advance of the assignment. The Cooperative's consent will be at the Cooperative's discretion and based on a determination of whether the Assignee is financially and technically capable to assume ownership and operation of the DG Facility. The company or individual to which this Agreement is assigned shall be responsible for the proper operation and maintenance of the DG Facility, and will be a Party to all provisions of this Agreement.

SECTION XV. HEADINGS

The descriptive headings of the various articles and sections of this Agreement have been inserted for convenience of reference only and are to be afforded no significance in the interpretation or construction of this Agreement.

SECTION XVI. MULTIPLE COUNTERPARTS

This Agreement may be executed in two or more counterparts, each of which is deemed an original but all constitute one and the same instrument.

SECTION XVII. NOTICES

Notices given under this Agreement are deemed to have been duly delivered if hand delivered, sent by facsimile machine with printed confirmation, or sent by United States certified mail, return receipt requested and received, postage prepaid, to:

(a) If to Cooperative:

Renewable Energy Engineer Concho Valley Electric Cooperative 2530 Pulliam St. San Angelo, Texas 76905

Phone: 325-655-6957 Email: dg@cvec.coop

(b) If to Member:	
Name:	
Address:	
City, State, Zip:	
Phone:	
Email:	

The above-listed names, titles, and addresses of either Party may be changed by written notification to the other.

SECTION XVIII. LIMITATIONS

This Agreement is not intended to, and does not create, rights, remedies, or benefits of any character whatsoever in favor of any persons, corporations, associations, or entities other than the Parties. The failure of a Party to this Agreement to insist, on any occasion, upon strict performance of any provision of this Agreement will not be considered to waive the obligations, rights, or duties imposed upon the Parties.

SECTION XIV. AMBIGUITIES

The rule of construction that ambiguities in a document will be construed against the party who drafted it will not be applied in interpreting this Agreement.

[signature page follows]

IN WITNESS WHEREOF, the Parties have carespective duly authorized representatives.	
COOPERATIVE:	
CONCHO VALLEY ELECTRIC COOPERATIVE, I	NC.
SIGNATURE:	
TITLE:	
DATE:	
MEMBER:	
PRINT:	
SIGNATURE:	
TITLE:	
DATE:	

Exhibit A

Concho Valley Electric Cooperative Application for Interconnection and Operation of Customer-Owned Generation ("Application")

This Application should be completed as soon as possible and returned to a Cooperative representative to begin processing the request.

INFORMATION: This Application is used by the Cooperative to determine the required equipment configuration for the Member interconnection. Every effort should be made to supply as much information as possible.

as possible.		
PART 1		
Member/Applic	ant Information	ı
Member:		
Mailing Address:		
Email Address:		
		State:Zip Code:
Phone Number:		CVEC Account #:
CVEC Meter #:		
	(Ownership and Possession
Yes	No	
		Is the owner of the DG Facility the Member/Applicant listed above?
		Is the owner of the DG Facility also the owner of the property where the DG Facility is located?
		If NO , then who is the owner of the property?
Legal Name Type of Entity		
DBA (if ap	oplicable)	
		The Member name shown on the electric bill is the name Concho Valley Electric Cooperative will use for the Interconnection Agreement. Is the owner of the DG Facility (listed above) the same as on the electric bill?

PROJECT DESIGN/ENGINEERING (as applicable) Company:____ Mailing Address: City:_____County:____State:____Zip Code:_____ Phone Number: Representative: **ELECTRICAL CONTRACTOR** (as applicable) Company: Mailing Address: City: _____ County: ____ State: ____ Zip Code: _____ Phone Number: Representative: **TYPE OF GENERATOR** (check if applicable) Wind _____ Photovoltaic_____ Microturbine_____ Diesel Engine _____ Gas Engine _____ Turbine Other **ESTIMATED LOAD INFORMATION** The following information will be used to help properly design the Cooperative customer interconnection. This information is not intended as a commitment or contract for billing purposes. Total Site Load (kW AC) Total DG Output (kW AC) MODE OF OPERATION (check all that apply) If DG Owner/Operator does not plan on connecting to the grid, the DG Facility will be operating in isolated mode. If DG Owner/Operator plans to connect (or stay connected) to the grid, the DG Facility will be paralleling. If DG Owner/Operator intends to generate more than total site load, the DG Facility is exporting power. Paralleling_____ Power Export_____ Isolated If exporting power, what is the maximum amount expected? _____ Adding equipment to an existing DG Facility (Yes or No): If YES, include specifications of existing DG Facility in the "Description of Proposed Installation and Operation" on the next page (type of DG Facility, rated power of existing DG Facility, etc.).

Description of Proposed Installation and Operation

Give a general description of the principle Distributed Generation.	roposed installation, including when	you plan to operate the
PART 2		
Equipment Details		
	his page as required for additional DGs	.)
BATTERY EQUIPMENT		
(Skip if batteries are not incorporated	in your DG Facility.)	
Number of Batteries		
Manufacturer:	Model:	
Rated Voltage (Volts):	_Rated Amperes (A):	_
Total Rated Kilowatts (kW DC):	Total Rated Kilowatt-Hours (kWh):	

SOLAR EQUIPMENT

Inverter Information			
Quantity:Power Rating per inverter (watts):			
Total Maximum AC Po	wer Output (kW AC):		
Manufacturer:	Mode	el:	
Rated Power Factor (%	s):Rated Voltage (Volts):	Rated Amperes:	
Inverter Type (ferrores	sonant, step, pulse-width modulation	, central, micro, string etc.): _	
Harmonic Distortion: N	Maximum Single Harmonic (%)		
Maximum Total Harmo	onic (%)		
UL – 1741 Certified (Ye	es or No):		
Note: Attach all availa voltage and current wo	able calculations, test reports, and os aveforms.	cillographic prints showing in	verter output
Solar Panel Information	on		
Quantity:	Power Rating (watts):	Total DG Output	(kW DC)
Manufacturer:	Mode	el:	
WIND EQUIPMENT Inverter Information			
	_Power Rating (watts):		
Manufacturer:	Mode	el:	
	Rated Amperes:		
Single Phase:	UL-1741 Certified	(Yes or No):	-
Wind Turbine Informa	tion		
Quantity:	_Power Rating (watts):	<u></u>	
Manufacturer:	Model:		
GENERATOR EQUIPMI	ENT		
(Skip if generator is no	t incorporated in your DG Facility.)		
Manufacturer:	Mode	el:	
Rated Voltage (Volts):	Rated Amperes (A):		

Transfer Switch Manufacturer:	Transfer Switch Model:
Total Rated Kilowatts (kW DC):	Transfer Switch – Auto or Manual

Part 3

Layout & One-Line Sketch and Placards

Concho Valley Electric Cooperative requires a visible, lockable, labeled AC disconnect ("VLLD") for interconnection. The AC disconnect must have a visual break (with external handle) that is appropriate to the voltage level, be accessible to Cooperative personnel, and is capable of being locked in the open position. The Cooperative requests the VLLD be located on an exterior wall and within ten feet from the Cooperative's billing meter; only under approved exception should it be located elsewhere. If the VLLD is more than ten feet from the Cooperative meter, then the Cooperative requires a site directory placard (indicating the location of the VLLD) be placed on the Member's equipment beside the Cooperative's meter. Note that a second meter (provided by the Cooperative) is required at the DG Facility for the purpose of metering the output of the DG Facility (see the example layout sketch and one-line diagram below).

Along with this Exhibit A, the Cooperative requires a sketch depicting the physical layout (layout sketch) and one-line diagram be submitted with the interconnection Application. The one-line diagram shows the sequence of the Cooperative meters, the VLLD and the generation equipment. The layout sketch is an overhead view of the physical layout between the Cooperative meter, the VLLD and the distance between the two. Generic examples of these sketches are provided at the end of this Application for guideline purposes.

Checklist for Layout Sketch				
Yes	No			
		Did you identify the address on the layout sketch?		
		Did you identify the location of the Cooperative billing meter, the DG Output meter, the Visible, Lockable, Labeled, Disconnect (VLLD), and the distance between the two?		
		Does the layout sketch have the words "Visible, Lockable, Labeled, Disconnect" written on the sketch?		
		Is the VLLD located within ten feet of the Cooperative meter?		
		If No, then did you provide placard proofs that will be used at or near the Cooperative meter base showing the location of the VLLD?		
Checklist for One-Line Diagram				
Yes	No			
		Did you identify the address on the one-line diagram?		
		Did you identify the location of the Cooperative billing meter, the DG Output meter, the VLLD, and the generation equipment?		
		Does the one-line diagram have the words written on the sketch that show the location of the Cooperative Billing meter, the DG Output meter, the VLLD, and the generation equipment?		

CAUTION OR WARNING PLACARD LANGUAGE

Part A – Labeling for the Placard of Please indicate the placard warning	on Visible Disconnect ng language that will be utilized on the	VLLD: (or attached separately)
Examples:		
CAUTION Solar Generation Utility AC Disconnect	CAUTION POWER TO THIS SERVICE IS ALSO SUPPLIED FROM ON-SITE GENERATION AC SYSTEM DISCONNECT	WARNING Wind Generation Utility AC Disconnect
Please indicate the placard warning	ling Visible Disconnect Location Langua ng language that will be utilized at the Cooperative meter: (or attach separat	Cooperative meter if the VLLD is
Examples:		

CAUTION


POWER TO THIS SERVICE IS ALSO
SUPPLIED FROM ON-SITE
GENERATION AC SYSTEM
DISCONNECT IS LOCATED ON SOUTH
WALL OF DETACHED GARAGE

WARNING

POWER TO THIS SERVICE IS ALSO
SUPPLIED FROM ON-SITE
GENERATION AC SYSTEM
DISCONNECT IS LOCATED ON WEST
WALL OF THIS STRUCTURE

Layout Sketch Requirements



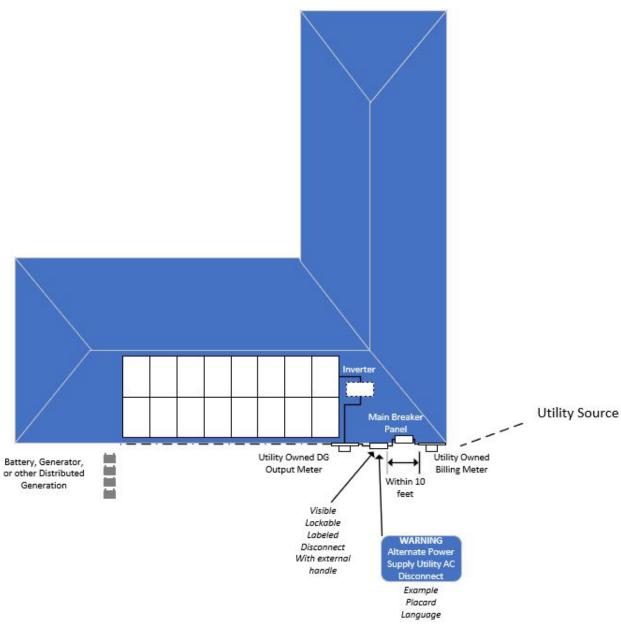

Name:


Address:

City, State, Zip:

Utility Meter Number:

One Line Requirements



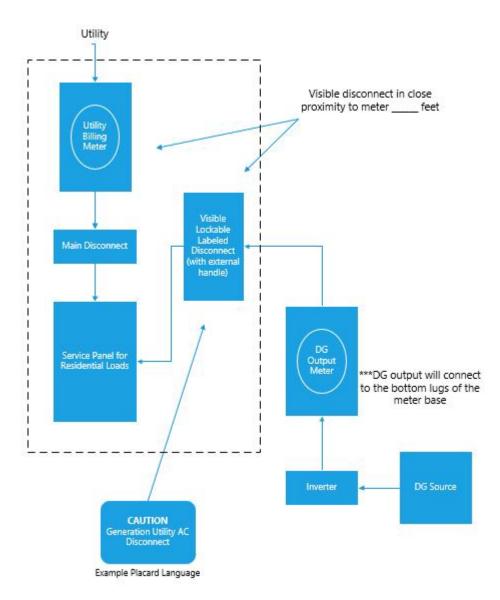

Name:

Address:


City, State, Zip:

Utility Meter Number:

One Line Requirements




Distribution Generation Solar Installation

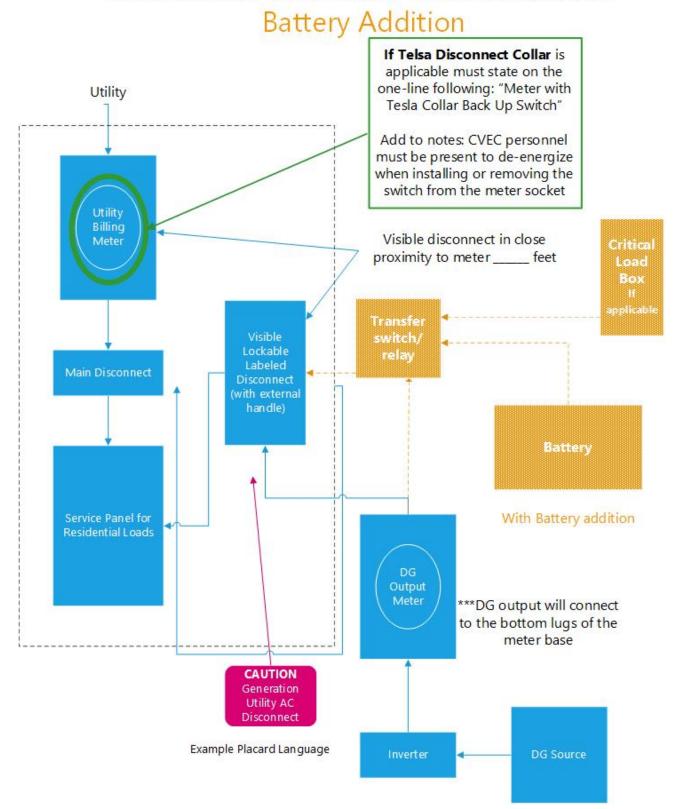




Distribution Generation Solar Installation Battery Addition Generator Addition

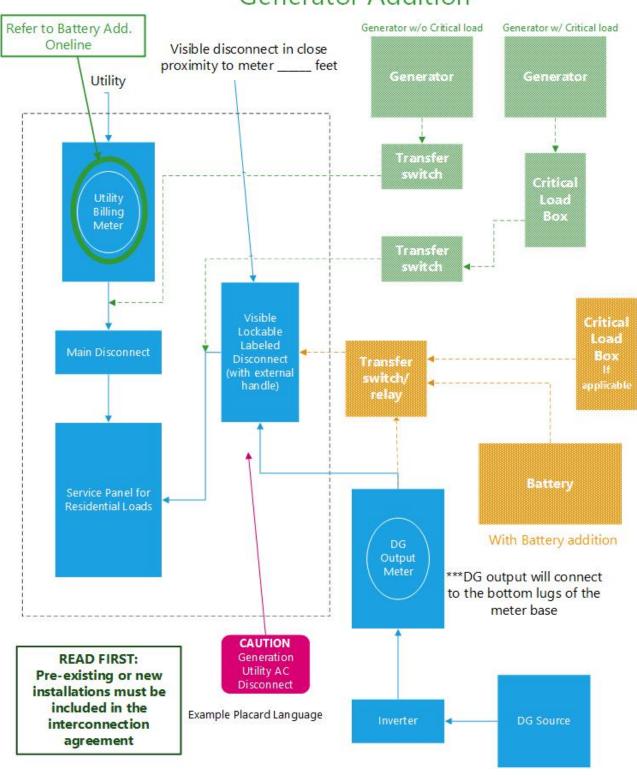

DG Output Meter Wiring Requirements

When installing the DG output meter base, Concho Valley Electric Cooperative requires the DG output conductors wired to the bottom lugs of the meter base. This information is mainly for the electrician that is installing the DG Facility. The DG Facility will not be approved if the meter base is not wired as directed. Concho Valley Electric Cooperative will provide a meter upon inspection.

Refer to this reference drawing:

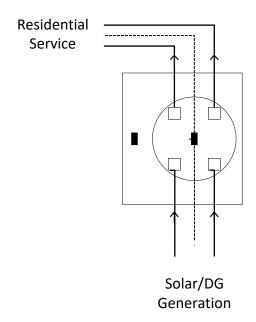

MEMBER CERTIFICATION AND AGREEMENT

The Member certifies that, to the best of its knowledge, the information provided in this Application is true. The Member agrees to provide the Cooperative with any additional information required to complete the interconnection. The Member shall operate its equipment within the guidelines set forth by the Cooperative. The Member further agrees to assign the energy generated by its renewable energy Distributed Generation Facility to Cooperative and to relinquish in favor of Cooperative any claims to any Renewable Energy Credits (RECs) related to the energy production associated with the equipment made part of this agreement.

Applicant	Date

Once this Application is submitted to the proper Cooperative contact and the DG Facility is constructed, an inspection will be scheduled. If the DG Facility is approved for operation, a Permission to Operate (PTO) document will be sent to the Member or their agent. The DG Facility should not be operated until the PTO is received.

CONCHO VALLEY ELECTRIC COOPERATIVE APPLICATION SUBMISSION LINK IS PROVIDED BELOW:

Scan QR code



https://wkf.ms/3tnJpNR

Renewable Energy Engineer Concho Valley Electric Cooperative 2530 Pulliam St. San Angelo, Texas 76905 Phone: 325-655-6957